



# FOOD TRUCK SAFETY



**CHECK** for an approved fire suppression system for cooking appliances. [NFPA 96:B.9.1.2]

**VERIFY** the fire suppression system service tag shows service every 6 months. [NFPA 17A:7.3.2]

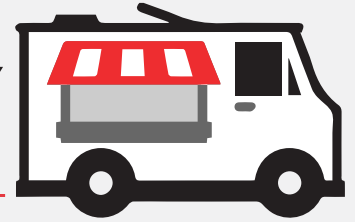

**VERIFY** ▶ Class K fire extinguishers are installed for cooking appliance fires. [NFPA 96, B.9.7.2]

▶ additional fire extinguishers are installed for other hazards. [NFPA 96, B.9.7.4]

▶ that there is an instructional placard at each Class K extinguisher. [NFPA 96, B.9.1.3]


▶ that a 20-B:C rated extinguisher is installed wherever an electrical generator is used. [NFPA 96: B.9.7.5]

▶ that every extinguisher has an annual service tag. [NFPA 96, B.9.7.6]




For solid fuel cooking appliances that produce grease, **CHECK** ▶ for an approved fire suppression system. [NFPA 96:B.10.6.1]

▶ that a water-based fire extinguisher is installed for the extinguishment of wood and charcoal fuels. [NFPA 96:B.10.6.3]

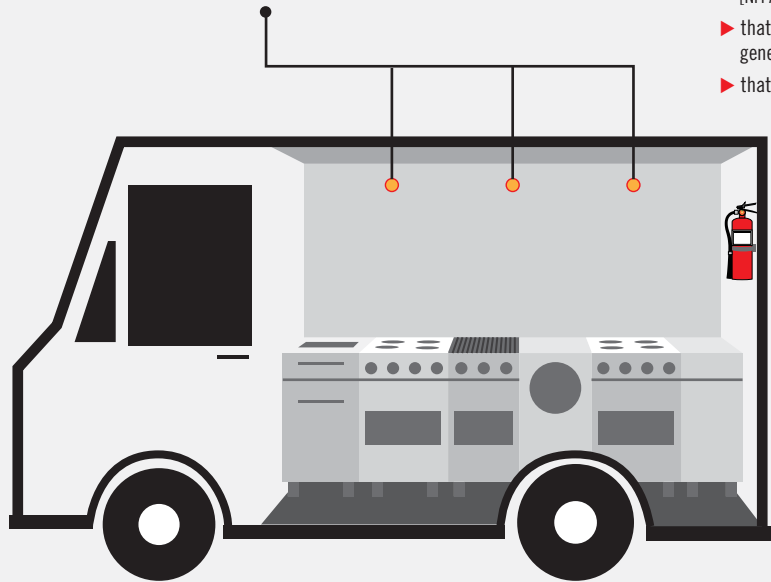

**ENSURE**

at least one worker is trained in the following: [NFPA 96:B.15.1]

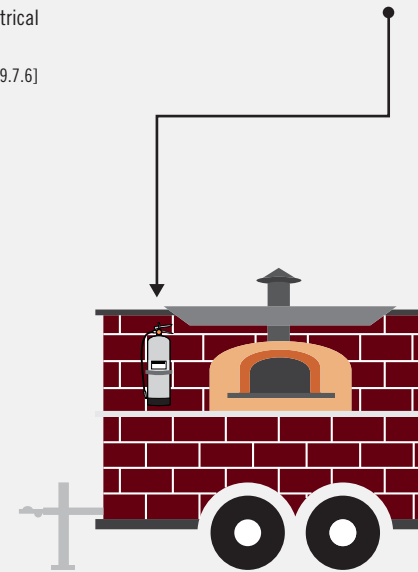

Using portable fire extinguishers. [NFPA 96:B.15.1]



Manually discharging the fire suppression system. [NFPA 96:B.15.1]



Proper method of shutting off fuel sources [NFPA 96:B.15.1]



Proper procedure for how to perform simple leak test on gas connections. [NFPA 58:6.16, 58:6.17]

**DOCUMENT**

initial and annual training and make it available to the fire department upon request. [NFPA 96:B.15.4, B.15.5]



**VERIFY**

the vehicle is jacked or wheel chocks are installed around wheels [NFPA 96:B.13.3] and that there is at least 10 ft clearance from buildings or structures, combustible materials, vehicles, and other cooking operations. [NFPA 1:50.7.1.5]



**VERIFY ACCESS & ENSURE CLEARANCE**

Verify fire department vehicular access is provided for fire lanes, access roads, fire hydrants, and fire department connections. [NFPA 1:50.7.17]